


ELEVATION

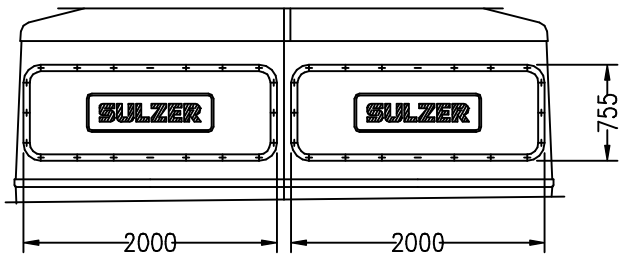


VIEW A
200

REMOVABLE ACCESS PANEL FOR INSPECTION OF FILL

A
200

M-PACK AIR INTAKE LOUVRES ON ALL FOUR SIDES

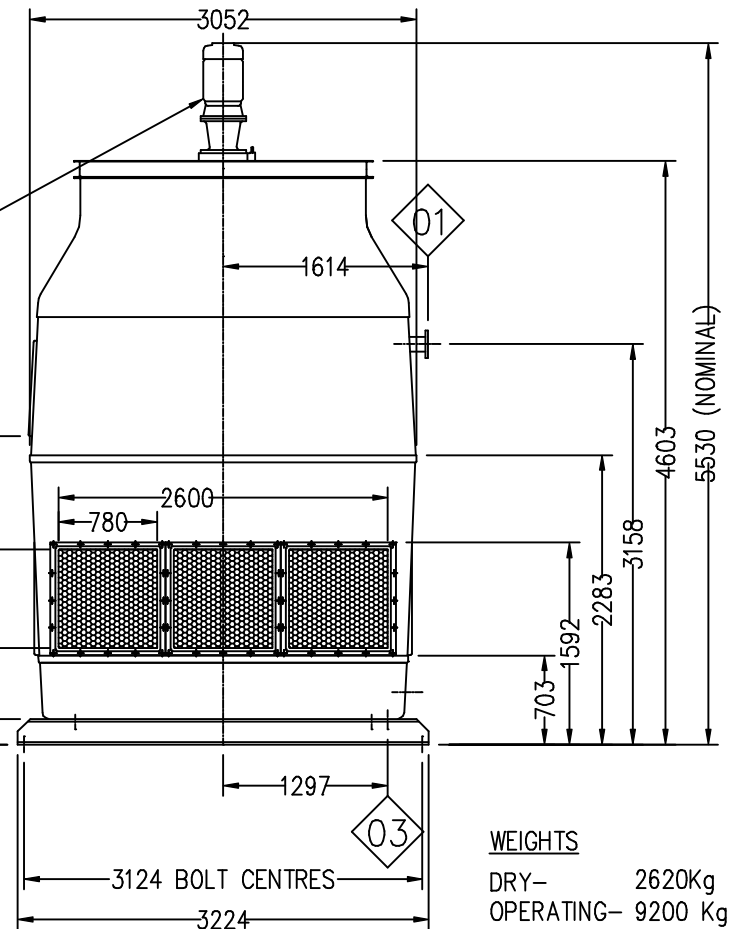

SIDE ELEVATION

WEIGHTS

DRY- 2620Kg
OPERATING- 9200 Kg

TERMINATION POINT

- 01-HOT WATER INLET 4 x 100NB FLANGE TABLE E AS.2129
- 02-COLD WATER OUTLET 2 x 200NB FLANGE TABLE E AS.2129
- 03-DRAIN OUTLET 2 x 50NB FLANGE TABLE E AS.2129
- 04-OVERFLOW CONNECTION 2 x 50NB BSP FEMALE
- 05-MAKE-UP WATER CONNECTION 20NB BSP MALE
- 06-QUICK FILL CONNECTION 20NB BSP MALE

5	-	-	-	-	-
4	-	-	-	-	-
3	-	-	-	-	-
2	-	-	-	-	-
1	QUICK FILL CONNECTION ADDED	C.C.	Z.B.	B.S.	25.05.98
0	ORIGINAL ISSUE	M.S.	J.D.	B.S.	18.04.96
REV.	DESCRIPTION	DRAWN	CHECKED	APPROVED	ISSUE DATE

GENERAL NOTES:
DO NOT SCALE
ALL DIMENSIONS IN MILLIMETRES
GENERAL TOLERANCE UNLESS OTHERWISE STATED LINEAR ±5, ANGULAR

SUPERCHILL Australia
 Mechanical Services Pty Limited
 1201 070 700 000
 1201 070 700 000
 1201 070 700 000

CLIENT	-	CONTRACT No.	-
LOCATION	-	JOB No.	-
EQUIPMENT	COOLING TOWER	DWG. REPLACES BY	-
CAD FILE No.	1260 200	DWG. REPLACES	1260-100-001
SCALE	N.T.S.	SEP. PARTS LIST	NO

TITLE	EWK 1260 COOLING TOWER DIMENSION SHEET	DRAWN	M.S.
PLANT	COOLING TOWER	CHECKED	J.D.
DRG No.	EWK 1260 200	APPROVED	B.S.
DATE	18.04.96	DATE	18.04.96
SHEET SIZE	A3	REV.	1